



INSTRUCTION MANUAL IM-406

For Gas Turbine Tensioned Studs and Nuts

Applicable Bolting Connections


Fr. 6F.03 Gas Turbine to 6FA Generator	Fr. 7EA Gas Turbine to 7A6 Generator
Fr. 6F.03-FL18 Gas Turbine to 6FA Generator	Fr. 7EA Gas Turbine to Load Coupling
Fr. 6F.03-FL18 Load Gear to 6FA Generator	Load Coupling to 7A6 Generator
Fr. 6FA Gas Turbine to 6FA Generator	Fr. 7E.03 Gas Turbine to A36 Generator
Load Gear to 6FA Generator	Fr. 7E.03 Gas Turbine to Load Coupling
Fr. 6F.01 Gas Turbine to Generator	Load Coupling to A36 Generator

Applicable GE Ordering Sheet Part Numbers

102T1200P001	131T2640P0001	134T7922P0001	358A7395G001	381A6850P001
102T1200P002	131T2640P0002	134T7922P0002	358A7395P001	381A6850P016
102T1200P003	131T2640P0005	134T7922P0003	358A7395P003	381A6850P017
102T1200P004	131T2640P0006	134T7922P0004	358A7395P005	381A6850P018
102T1200P005			358A7395P007	381A6850P019
	133T8375P0001		358A7395P009	381A6850P020
114T4434P007	133T8375P0002		358A7395P010	381A6850P021
114T4434P008	133T8375P0004			381A6850P022
114T4434P009	133T8375P0007			381A6850P023
				381A6850P024

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

 GE Power & Water		GENERAL ELECTRIC COMPANY	
<u>VENDOR SUPPLIED</u>			
GE NOT TO REVISE. GE REVISION LEVEL IS SHOWN ON THIS APPLIQUE. THIS DOCUMENT IS FILED UNDER THE GE DRAWING NUMBER.			
THIS DOCUMENT SHALL BE REVISED IN ITS ENTIRETY. ALL SHEETS OF THIS DOCUMENT ARE THE SAME REVISION LEVEL AS INDICATED IN THIS VENDOR SUPPLIED DRAWING APPLIQUE.			
MLI: _____		OF _____	
GE SIGNATURES	DATE	GE DRAWING NUMBER	REV
CHECKED: _____	_____	373A4099	
ISSUED: _____	_____		

The Riverhawk Company reserves the right to update this document without dissemination or notice. The latest revision may be obtained by contacting Riverhawk Company or thru www.riverhawk.com.



Repairs – Rentals
Field Service

215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

IM-406 Revision G
Page 1 of 50

Table of Contents

Section	Description	Page Number
1.0	Cautions and Safety Warnings	3
2.0	Scope and GE Part Number Cross Reference	5
3.0	Quick Checklist	10
4.0	General Preparations	14
5.0	Hardware Set Preparations	17
6.0	Stud and Nut Assembly	20
7.0	Hydraulic Tensioner Equipment Assembly	23
8.0	Assembly of Tensioner on Stud	26
9.0	Stud Tensioning	31
10.0	Thread Locking the Nut	34
11.0	Stud and Nut Removal	35
12.0	Storage Instructions	40
13.0	Frequently Asked Questions	41
14.0	Revision History	43
Appendix A1	EC Declaration of Conformity	44
Appendix A2	UKCA Declaration of Conformity	45
Appendix B1	18-Bolt Tensioning Pattern (6FA LG-GEN) Record Sheet	46
Appendix B2	18-Bolt Tensioning Pattern (6F.03 LG-GEN) Record Sheet	47
Appendix B3	18-Bolt Tensioning Pattern (6F.01 LG-GEN) Record Sheet	48
Appendix B4	12-Bolt Tensioning Pattern (7EA/7E.03 GT-LC) Record Sheet	49
Appendix B5	18-Bolt Tensioning Pattern (7EA/7E.03 LC-GEN) Record Sheet	50



215 Clinton Road
 New Hartford, NY 13413
 Tel: +1 315 768 4855
 Fax: +1 315 768 4941
 Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
 CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

1.0 Cautions and Safety Warnings

WARNING

Improper tool use and the failure to follow the correct procedures are the primary root causes of tool failures and personal injuries. A lack of training or experience can lead to incorrect hardware installation or incorrect tool use. Only trained operators with careful, deliberate actions should use hydraulic tensioners. Contact Riverhawk Company with any training needs.

WARNING

Risk of high pressure hydraulic fluid injection. Riverhawk tools operate under high pressure. Thoroughly inspect all hoses and connections for damage or leaks prior to using this equipment.

CAUTION

Personal injury and equipment damage can occur if the proper health and safety codes and procedures are not followed. Contact the site's health and safety office to determine all applicable safety rules and regulations.

WARNING

The proper personal protective equipment must be worn at all times. Riverhawk recommends at a minimum, safety glasses, long sleeve shirt, hard hat, heavy work gloves, and steel toe shoes.

CAUTION

It is especially important to check the condition of the conical thread used to tension the stud. Thread damage from previous abuse can lead to failure of the stud or tensioning equipment

CAUTION

Riverhawk recommends that the tensioner should be returned to Riverhawk for periodic inspections. Replacement of obsolete tensioners is recommended. Functional upgrades are also recommended. Riverhawk should be notified 3-6 months prior to a planned outage to schedule an inspection service.

WARNING

A damaged burst disc must be replaced with a burst disc of the same design and pressure rating. Do not substitute a damaged burst disc with a different disc type, a different pressure rating, or a foreign object.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 3 of 50

WARNING

To avoid failure, ensure safety, and proper operation, the tensioner assembly must be installed on a stud in the flange before bleeding and pressurizing the tensioner. Do not use the tensioner at any pressure unless the tool is installed on a stud in a flange.

CAUTION

Personal injury and equipment damage can occur if the puller screw is not securely engaged with the tapered threads of the stud. Proper engagement is achieved when the puller screw is tight in the stud and the tensioner assembly is free to turn.

WARNING

The safety cage must be in place at all times. When the tensioner is pressurized hands must be kept out of designated areas to avoid any potential for personal injury.

CAUTION

Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. This procedure will ease assembly and assure positive mating of the threads before tightening. Do not use "Never Seize" on the conical threads.

CAUTION

Do not tighten the nut while the tool is coming up to pressure; wait until pressure is achieved before attempting to tighten the nut with the spanner ring. If the tool is not properly installed, the tool could jump off the stud while coming up to pressure.

CAUTION

Do not exceed the maximum pressure marked on the tensioner. Excessive pressure can damage the stud and the tensioner.

WARNING

FIRE HAZARD: DO NOT apply heat when tensioner is in place. Personal injury or equipment damage may occur. Use of an Oxy-Acetylene torch is not recommended.

WARNING

Do not use a hydraulic tensioner to remove a stud with damaged conical threads.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

2.0 Scope and GE Part Number Cross Reference

This document describes the procedure to be used to install the stud and nut sets supplied by the Riverhawk Company in the flange at the Load Gear/Generator connection. The Gas Turbine/Load Coupling and Load Coupling/Gearbox connections are described by a different manual as listed in the following sections.

The various frame configurations covered in this manual are listed in Sections 2.1 through 2.13 with differences as related to connective hardware defined. Listed also are the pertinent hardware drawings (HF-xxxx). These drawings as well as tooling drawings (HT-xxxx) form part of this manual.

2.1 6F.03 Gas Turbine to 6FA Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
133T8375P0001	HF-8730	GE 101B0754

The hydraulic tooling used for installation and removal is Riverhawk HT-6745 (load coupling) and HT-6754 (generator).

This hardware drawing depicts the complete stud and nut package for the Gas Turbine to Load Coupling (1-1/8" size, Qty 27) and Load Coupling to Gearbox (1-1/8" size, Qty 27) as well as the Gearbox to Generator (2" size, Qty 18).

Note: This manual describes HT-6754 tensioner (2" hardware) **only**.

See manual IM-364 (GE 373A4078) for instructions for HT-6745.

2.2 6F.03-FL18 Gas Turbine to 6FA Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
131T2640P0001	HF-8471	GE 101B0745

The hydraulic tooling used for installation and removal is Riverhawk HT-6745 (load coupling) and HT-6754 (generator).

This hardware drawing depicts the complete stud and nut package for the Gas Turbine to Load Coupling (1-1/8" size, Qty 27) and Load Coupling to Gearbox (1-1/8" size, Qty 27) as well as the Gearbox to Generator (2" size, Qty 18).

Note: This manual describes HT-6754 tensioner (2" hardware) **only**.

See manual IM-364 (GE 373A4078) for instructions for HT-6745.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

2.3 6F.03-FL18 Load Gear to 6FA Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
131T2640P0006	HF-8472	GE 101B0746

The hydraulic tooling used for installation and removal is Riverhawk HT-6754 (generator).

This hardware drawing depicts the complete stud and nut package for the Gearbox to Generator (2" size, Qty 18).

2.4 6FA Gas Turbine to 6FA Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
381A6850P001	HF-0737	GE 359B2521
381A6850P019	HF-0737	GE 359B2521
381A6850P020	HF-0737	GE 359B2521
381A6850P021	HF-8028	GE 101B0717
381A6850P022	HF-8028	GE 101B0717

The hydraulic tooling used for installation and removal is Riverhawk HT-6745 (load coupling) and HT-6754 (generator).

These hardware drawings depict the complete stud and nut package for the Gas Turbine to Load Coupling (1-1/8" size, Qty 27) and Load Coupling to Gearbox (1-1/8" size, Qty 27) as well as the Gearbox to Generator (2" size, Qty 18).

Note: This manual describes HT-6754 tensioner (2" hardware) **only**.

See manual IM-364 (GE 373A4078) for instructions for HT-6745.

2.5 Load Gear to 6FA Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
133T8375P0007	HF-8736	GE 101B0758
381A6850P023	HF-8029	GE 101B0718

The hydraulic tooling used for installation and removal is Riverhawk HT-6754 (generator).

This hardware drawing depicts the complete stud and nut package for the Load Gear to Generator (2" size, Qty 18).



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

2.6 6F.01 Gas Turbine to Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
114T4434P007	HF-7565	GE 101B0684
114T4434P008	HF-7565	GE 101B0684

The hydraulic tooling used for installation and removal is Riverhawk HT-6865 (load coupling) and HT-6754 (generator).

These hardware drawings depict the complete stud and nut package for the Gas Turbine to Load Coupling (1-1/8" size, Qty 24) and Load Coupling to Gearbox (1-1/8" size, Qty 24) as well as the Gearbox to Generator (2" size, Qty 18).

Note: This manual describes HT-6754 tensioner (2" hardware) **only**.

See manual IM-367 (GE 373A4081) for instructions for HT-6865.

2.7 7EA Gas Turbine to 7A6 Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
102T1200P001	HF-5416	GE 269B8718
102T1200P002	HF-5416	GE 269B8718

The hydraulic tooling used for installation and removal is Riverhawk HT-6754. HT-6754 supersedes an older model tensioner HT-5210.

HT-6754 and HT-5210 can also be used on these other tensioned hardware sets.

GE Part Number	Riverhawk P/N	GE VENDOC P/N
358A7395P001	HF-0746	GE 269B8685
358A7395P001	HF-0220 (Obsolete)	

These hardware drawings depict the complete stud and nut package for the Gas Turbine to Load Coupling (2" size, Qty 12) and the Load Coupling to Generator (2" size, Qty 18).

2.8 7EA Gas Turbine to Load Coupling

GE Part Number	Riverhawk P/N	GE VENDOC P/N
102T1200P004	HF-5417	GE 269B8719



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

The hydraulic tooling used for installation and removal is Riverhawk HT-6754. HT-6754 supersedes an older model tensioner HT-5210.

HT-6754 and HT-5210 can also be used on these other tensioned hardware sets.

GE Part Number	Riverhawk P/N	GE VENDOC P/N
358A7395P003	HF-0747	GE 359B2513
358A7395P003	HF-0275 (Obsolete)	
358A7395P007	HF-0747	GE 359B2513
358A7395P007	HF-0275 (Obsolete)	
358A7395P009	HF-0841	

These hardware drawings depict the complete stud and nut package for the Gas Turbine to Load Coupling (2" size, Qty 12).

2.9 Load Coupling to 7A6 Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
102T1200P005	HF-5418	GE 269B8720

The hydraulic tooling used for installation and removal is Riverhawk HT-6754. HT-6754 supersedes an older model tensioner HT-5210.

HT-6754 and HT-5210 can also be used on these other tensioned hardware sets.

GE Part Number	Riverhawk P/N	GE VENDOC P/N
358A7395G001	HF-0748	GE 359B2504
358A7395P005	HF-0748	GE 359B2504
358A7395P005	HF-0276 (Obsolete)	
358A7395P010	HF-0842	

These hardware drawings depict the complete stud and nut package for the Load Coupling to Generator (2" size, Qty 18).

2.10 7E.03 Gas Turbine to A36 Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
134T7922P0001	HF-8910	GE 101B0771

The hydraulic tooling used for installation and removal is Riverhawk HT-6754.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 8 of 50

This hardware drawing depicts the complete stud and nut package for the Gas Turbine to Load Coupling (2" size, Qty 12) and the Load Coupling to Generator (2" size, Qty 18).

2.11 7E.03 Gas Turbine to Load Coupling

GE Part Number	Riverhawk P/N	GE VENDOC P/N
134T7922P0003	HF-8946	GE 101B0772

The hydraulic tooling used for installation and removal is Riverhawk HT-6754.

This hardware drawing depicts the complete stud and nut package for the Gas Turbine to Load Coupling (2" size, Qty 12).

2.12 Load Coupling to A36 Generator

GE Part Number	Riverhawk P/N	GE VENDOC P/N
134T7922P0004	HF-8947	GE 101B0773

The hydraulic tooling used for installation and removal is Riverhawk HT-6754.

This hardware drawing depicts the complete stud and nut package for the Load Coupling to Generator (2" size, Qty 18).

2.13 Hydraulic Tooling

GE Part Number	Riverhawk P/N	GE VENDOC P/N
102T1200P003	HT-6754 MP-0130	GE 101B0647 GE 359B2506
114T4434P009	HT-6865 HT-6754 AP-0532	GE 101B0649 GE 101B0647 GE 359B2502
131T2640P0002	HT-6745 HT-6754 AP-0532	GE 101B0656 GE 101B0647 GE 359B2502
131T2640P0005	HT-6745	GE 101B0656



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

133T8375P0002	HT-6745 HT-6754 AP-0532	GE 101B0656 GE 101B0647 GE 359B2502
133T8375P0004	HT-6754 AP-0532	GE 101B0647 GE 359B2502
137T7922P0002	HT-6754 AP-0532	GE 101B0647 GE 359B2502
381A6850P016	HT-6745	GE 101B0646
381A6850P017	HT-6745	GE 101B0646
381A6850P018	HT-6754	GE 101B0647
381A6850P019	HT-6745 HT-6754 AP-0532	GE 101B0646 GE 101B0647 GE 359B2502
381A8650P020	HT-6745 HT-6754 AP-0532	GE 101B0646 GE 101B0647 GE 359B2502
381A6850P024	HT-6754	GE 101B0647

Note: Hydraulic tooling list is for all related tooling for the gas turbine to generator connections.
This manual describes HT-6754 tensioner and HT-5210 (2" hardware) **only**.
See manual IM-364 (GE 373A4078) or IM-367 (GE 373A4087) for instructions to the other tooling listed above.

3.0 Quick Checklist

The following checklist is intended as a summary of the steps needed to use the Riverhawk-supplied equipment. New personnel or those experienced personnel who have not used the Riverhawk equipment recently are encouraged to read the entire manual.

EQUIPMENT INSPECTION

- ☐ Check oil level in hydraulic pump.
- ☐ Check air pressure at 80psi [5.5 bar] minimum. (For air-driven pumps)



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- ☐ Check hydraulic hose for damage.
- ☐ Test pump.
- ☐ Inspect tensioner for any damage.

NUT AND STUD PREPARATION

- ☐ Inspect studs and nuts for any damage.
- ☐ Clean the studs and nuts.
- ☐ Measure stud lengths. (VERY IMPORTANT)
- ☐ Install studs and nuts into the flange. The studs are not centered in the flange.
- ☐ Set stick-out dimension on the gearbox side of the flange for the 6FA and 6F.01 or on the load coupling side of the flange for the 7EA and 7E.03.
- ☐ Hand tighten the nuts on the generator side of flange for the 6FA and 6F.01. For the 7EA and 7E.03, hand tighten the nuts on the gas turbine side or generator side of the flange.
- ☐ Verify stick-out measurement (**VERY IMPORTANT**)

TENSIONING (Bolt Installation)

- ☐ Check tensioner drawing for correct parts and part numbers.
- ☐ Apply a light coat of clean turbine oil or spray lubricant to the puller screw. **DO NOT USE "NEVER SEIZE" ON THE CONICAL THREADS.**
- ☐ Thread the puller screw into the stud.
- ☐ Install the spanner ring onto the nut.
- ☐ Insert an Allen wrench into the back side of the stud.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- ☐ Insert another Allen wrench into the puller screw. While holding the stud still, tighten the puller screw until hand tight and then loosen the puller screw 1/2 of a turn.
- ☐ Retighten the puller screw until slightly hand tight. **DO NOT BACK OFF PULLER SCREW.**
- ☐ Slide the foot over the puller screw and orientate the foot into position.
- ☐ Thread the tensioner onto puller screw until it stops. There should be a 1/16" to 3/16" gap between the foot and tensioner.
- ☐ Place the guard over the tensioner and position the guide pin into the hole in the backside of the stud.
- ☐ Tighten the guard's knurled interlock fitting by hand until it presses firmly against tensioner (no gap).
- ☐ Push the center of the interlock fitting towards the tensioner while pulling back on the fitting's pull tabs until it locks onto the tensioner and release the pull tabs.
- ☐ Connect the hydraulic pump to the tensioner and tension to 50%. Consult manual for correct pressure.
- ☐ Use the pin wrench to turn the spanner ring to firmly tighten nut with 10 ft·lbs [13.5 N·m] of torque.
- ☐ Release pressure and allow the tensioner to fully retract.
- ☐ Disconnect the hose and release the interlock fitting by pushing the center of the interlock fitting towards the tensioner while pulling back on the fitting's pull tabs.
- ☐ Loosen the knurled interlock fitting and remove the guard.
- ☐ Unscrew the tensioner from the puller screw.
- ☐ Remove the foot, the puller screw, and the spanner ring.
- ☐ Move to the next stud in the pattern and repeat the previous steps. Tension all studs to 50% before proceeding to final pressure.
- ☐ Repeat above steps at final pressure.



215 Clinton Road
 New Hartford, NY 13413
 Tel: +1 315 768 4855
 Fax: +1 315 768 4941
 Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
 CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- ☐ Measure final stud length and record on stretch datasheets. Calculate stretch and verify per section 9.3.
- ☐ Torque the nuts' set screws.

DETENSIONING (Stud Removal)

- ☐ If present, loosen the windage plugs' set screws and remove the windage plugs from the studs.
- ☐ Loosen nuts' set screws
- ☐ Inspect and clean studs' conical threads. **Do not continue until ALL debris is removed from the threads!** See instruction manual IM-220. **Do not try to use the tensioner to remove a damaged stud!**
- ☐ Apply a light coat of clean turbine oil or spray lubricant to the puller screw. **DO NOT USE "NEVER SEIZE" ON THE CONICAL THREADS.**
- ☐ Thread the puller screw into the stud.
- ☐ Install the spanner ring onto the nut.
- ☐ Insert an Allen wrench into the back side of the stud.
- ☐ Insert another Allen wrench into the puller screw. While holding the stud still, tighten the puller screw until hand tight and then loosen the puller screw 1/2 of a turn.
- ☐ Retighten the puller screw until slightly hand tight. **DO NOT BACK OFF PULLER SCREW.**
- ☐ Slide the foot over the puller stud and orientate the foot into position.
- ☐ Thread the tensioner onto puller screw until it stops. There should be a 1/16" to 3/16" gap between the foot and tensioner.
- ☐ Place the guard over the tensioner and position the guide pin into the hole in the backside of the stud.
- ☐ Tighten the guard's knurled interlock fitting by hand until it presses firmly against tensioner (no gap).



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- ☐ Push the center of the interlock fitting towards the tensioner while pulling back on the fitting's pull tabs until it locks onto the tensioner and release the pull tabs.
- ☐ Connect the hydraulic pump to the tensioner and tension to final pressure. Consult manual for correct pressure per section 11.2.
- ☐ Loosen nut with the spanner ring and pin wrench.
- ☐ Release pressure and allow the tensioner to fully retract.
- ☐ Disconnect the hose and release the interlock fitting by pushing the center of the interlock fitting towards the tensioner while pulling back on the fitting's pull tabs.
- ☐ Loosen the knurled interlock fitting and remove the guard.
- ☐ Unscrew the tensioner from the puller screw.
- ☐ Remove the foot, puller screw, and spanner ring. It may be necessary to insert an Allen wrench into the backside of the stud to stop the stud from rotating.
- ☐ Move to the next stud in the pattern.

4.0 General Preparations

Read and understand all instructions before installing and tensioning studs.

Operators should be trained or have previous experience using Riverhawk tensioning equipment. Training will minimize the chance of improper use of the equipment.

The hydraulic tooling including the hydraulic hoses should be inspected prior to use. Inspection guidelines are listed in the following sub-sections.

This equipment produces very high hydraulic pressures and very high forces. Operators must exercise caution and wear the appropriate personal protective equipment when handling and operating the hydraulic tooling.

High-pressure oil from the hydraulic pump pressurizes the tensioner which generates a very large force that actually stretches the stud. As the stud is stretched the nut lifts off the flange. The nut is then turned by hand using the supplied spanner ring. Once the nut is tight against the



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

flange, the pressure in the tensioner is released. The hardware is now clamping the flange together.

4.1 Machine Preparation

The flange to be tensioned must be fully closed prior to positioning of studs in the flanges. There must be provisions for turning the shafts. Also, it will be advantageous to remove as many obstructions as possible from the flange area, such as speed probes, shipping plates, conduit, and other protective materials that may interfere with the tensioner.

4.2 Hardware – Balance

The studs are supplied in a component balanced set for the entire flange. A stud can be exchanged with another stud in its set without affecting the overall balance of the equipment. Do not exchange a stud from one set with another stud from a different set for another turbine. When shipped from Riverhawk, the studs are not assigned to any specific hole in the bolted flange; this is optional and can be done at the installation site. The set size is determined by the relevant GE order drawing (see section 2.0).

The nuts are supplied in component balanced sets for the entire flange. A nut can be exchanged with another nut in its set without affecting the overall balance of the equipment. Do not exchange a nut from one set with another nut from a different set for another turbine. When shipped from Riverhawk, the nuts are not assigned to any specific hole in the bolted flange; this is optional and can be done at the installation site. The set size is determined by the relevant GE order drawing (see section 2.0).

A weight balance certification is supplied with each order. Store this certification in an appropriate location as it will be needed for the acquisition of replacement equipment.

4.3 Tensioner – Care and Handling

When not in use, the tensioner shall be maintained in a clean environment and all caps and plugs for hydraulic openings and fittings must be in place.

Use ISO 32 grade oil.

When in use, the tensioner shall be protected from sand and grit.

See section 12 for long term storage requirements.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

4.4 Hand Tools

Several hand wrenches and micrometers may be required to perform installation and measurement of the studs:

5/8" Wrench	1' to 2' (30cm-60cm) Breaker Bar
3/4" Wrench	3' to 4' (90cm-120cm) Breaker Bar
A set of inch Allen Wrenches	5" to 6" (125mm-150mm) Micrometer or Caliper
1/2" Square Drive – 1/2" Hex-Bit Socket	8" to 9" (200mm-225mm) Micrometer or Caliper

4.5 Special Tools

Hydraulic Tensioner Kit: HT-5210 Hydraulic Tensioner, 2"
Superseded by HT-6746
(reference GE VENDOC 269B8696)

HT-6745 Hydraulic Tensioner, 1-1/8"
(see manual IM-364, GE VENDOC 373A4078)
(reference GE VENDOC 101B0646)

HT-6754 Hydraulic Tensioner, 2"
(reference GE VENDOC 101B0647)

HT-6865 Hydraulic Tensioner, 1-1/8"
(see manual IM-367, GE VENDOC 373A4081)
(reference GE VENDOC 101B0649)

Hydraulic Pump Kit: AP-0532 Air-Operated Hydraulic Pump
(reference GE VENDOC 359B2502)

MP-0130 Manual Hand-Operated Hydraulic Pump
(reference GE VENDOC 359B2506)

Stud Cleaning Kit: GT-4354 Stud Cleaning Kit
(recommended)
(reference GE VENDOC 373A4027)



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

CAUTION

Riverhawk recommends that the tensioners be returned to Riverhawk for periodic inspections. Replacement of obsolete tensioners is recommended. Functional upgrades are also recommended. The Riverhawk Service Returns Coordinator should be notified 3-6 months prior to a planned outage to schedule an inspection service.

5.0 Hardware Set Preparations

5.1 Nut Preparation



Picture 5A - Riverhawk Locknut

If there is any visible damage on a nut, do not use the nut and contact the Riverhawk Company for a replacement nut. Please be prepared to supply the turbine number, weight certification, and digital photographs for evaluation.

5.1.1 Nut Cleaning - New Installations

For new installations, the nuts should come sealed from the factory and will need no cleaning.

5.1.2 Nut Cleaning - Old Installations

Previously installed nuts require cleaning as follows: Wire brush using a petroleum-based solvent to remove any foreign material on the external surfaces and threads.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

5.2 Stud Preparation

Check the stud for any visible damage. If there is any visible damage, do not use the stud and contact the Riverhawk Company for a replacement stud. Please be prepared to supply the turbine number, weight certification, and digital photographs for evaluation.

CAUTION

It is especially important to check the condition of the conical thread used to tension the stud. Thread damage from previous abuse can lead to failure of the stud or tensioning equipment.

The conical threads of each stud must be clean of grit and dirt before installation or removal. This ensures the proper seating of the puller screw.

5.2.1 Stud Cleaning - New Installations

For new installations, the studs should come sealed from the factory and will need no cleaning.

5.2.2 Stud Cleaning - Old Installations

Previously installed studs may require cleaning. Clean conical threads should have a bright and shiny appearance.

If cleaning is required, follow these steps:

1. Blow out the threads with compressed air to remove loose debris and dry conical threads. Do not apply a solvent or other cleaning solution to the threads as this may chemically attack the stud.
2. Use Stud Cleaning Kit, GT-4354 or a similar 1/2" diameter Brass power brush.



Picture 5B - Brass Power Brush

3. Insert the brush into an electric drill and set drill to run in a counterclockwise direction at high speed.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

4. Work the drill in a circular motion while moving the brush in and out to clean all of the threads. Try not to hold the brush in one place too long, so as not to remove the stud's protective coating.
5. Blow out the threads with compressed air to remove loosened debris.
6. Visually inspect threads for cleanliness. Threads should be bright and shiny.
7. Repeat if any dirt can be seen in the threads.
8. Inspect threads for any damage that may have been caused by previous installation.
9. Do **not** apply "Never Seize" to the stud's threads.
10. Finish the cleaning process by rinsing in a volatile solvent such as acetone and allow the stud to dry.

5.2.3 Very Old Hardware Installations

Obsolete hardware sets employed a thread-locking compound which is visible as a grayish-green residue.

Riverhawk Company strongly recommends replacing this type with the current hardware that has a re-useable mechanical locking feature.

Special instructions are available from Riverhawk if it has been decided to continue to use the obsolete hardware.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

5.3 Stud Length Measurement

Measure and record the initial lengths of the studs. The following suggestions will improve your results.

- Plan to start and finish any flange in the same day.
- Studs and flange must be at the same temperature.
- Number each stud with a marker for later stretch measurement tracking.
- Mark the location of measurement on stud end with a permanent marker.
- Measure each stud to nearest 0.001 inch (.01 mm).
- Record each measurement on the supplied record sheets at the end of this manual.
- Do not allow the measuring instruments to sit in the sun.
- The same person should make all measurements.

6.0 Stud and Nut Assembly

Refer to the hardware assembly drawing (HF-xxxx) listed in Section 2.0 of the manual.

1. Assemble the cylindrical nut to the internal, conical thread end of the stud.
2. Slide the stud and cylindrical nut assembly into the flange as shown in Figures 6A, 6B, and 6C.

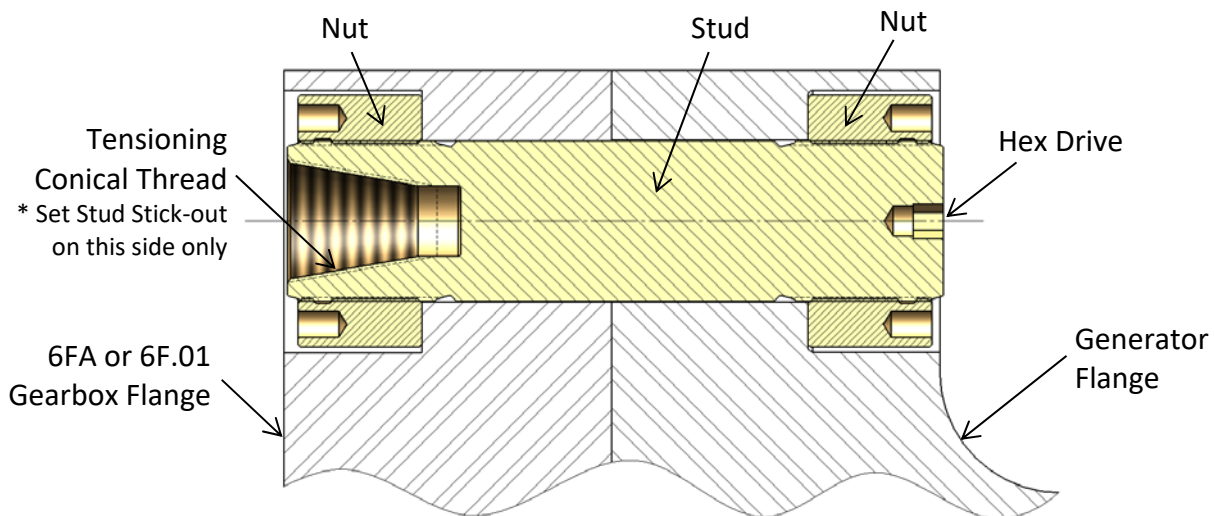


Figure 6A – Cross-section View of 6FA, 6F.03, or 6F.01 Gearbox to Generator Bolted Flange Connection



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 20 of 50

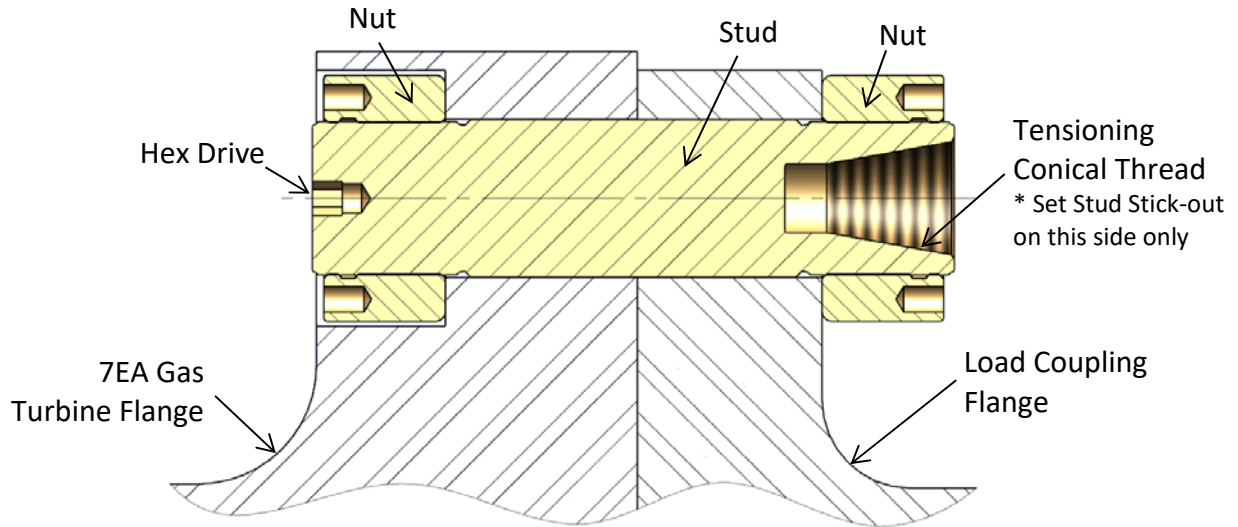


Figure 6B – Cross-section View of 7EA or 7E.03 Gas Turbine to Load Coupling Bolted Flange Connection

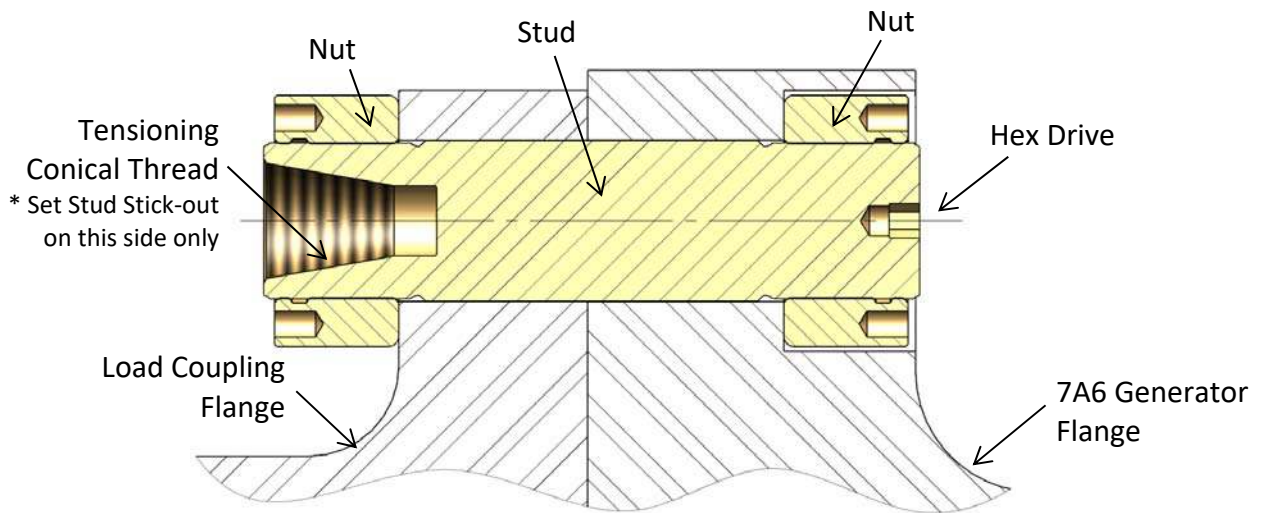


Figure 6C – Cross-section View of Load Coupling to 7A6 or A36 Generator Bolted Flange Connection

3. Install the other nut on the backside.
4. Adjust the nut/stud assembly so that the stud protrudes (or sticks out) from the face of the cylindrical nut the distance specified on the hardware drawing (HF-xxxx). **SETTING**



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 21 of 50

THIS PROTRUSION OF STUD TO NUT IS CRITICAL FOR PROPER TENSIONER OPERATION.
A metal stick-out gage is provided with the tensioner to assist the operator in setting the protrusion dimension.



Picture 6D – Use of Stick-Out Gage on the 6FA Generator stud



Picture 6E – Use of Stick-Out Gage on the 6F.03 Generator stud



Picture 6F – Use of Stick-Out Gage on the 6F.01 Generator stud



Picture 6G – Use of Stick-Out Gage on the 7EA stud




Figure 6H – Use of Stick-Out Gage on the 7E.03 stud



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

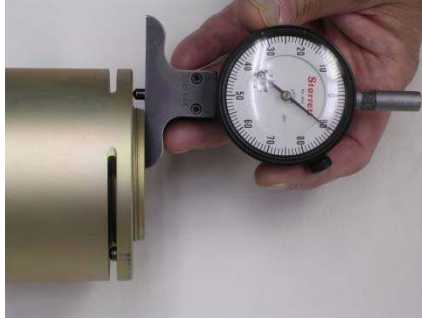

Picture 6J – Use of Drop Gage to measure stick-out



Picture 6K – Use of Calipers to measure stick-out

5. Hand tighten the assembly to a snug fit.
6. Recheck the stud stick-out length. If the stick-out length does not match the hardware drawing, adjust the nuts as necessary.

7.0 Hydraulic Tensioner Equipment Assembly

7.1 Hydraulic Equipment Inspection

7.1.1 Hydraulic Tensioner Inspection

CAUTION

Riverhawk recommends that the tensioner be returned to Riverhawk for periodic inspections. Replacement of obsolete tensioners is recommended. Functional upgrades are also recommended. Riverhawk should be notified 3-6 months prior to a planned outage to schedule an inspection service.

Do **not** bleed the air from the hydraulic lines and tensioner at this time. See section 8 for bleeding instructions on when to bleed the air from the hydraulic lines.

WARNING

To avoid failure, ensure safety, and proper operation, the tensioner assembly must be installed on a stud in the flange before bleeding and pressurizing the tensioner. Do not use the tensioner at any pressure unless the tool is installed on a stud in a flange.

Clean puller screw and check for any debris and dents.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 23 of 50

Inspect the tensioner guard for any signs of damage including cracked welds. Any guards modified in the field should be replaced. Bent guards should be replaced. Also, be sure the rubber pad is in place on the guard, if missing, replace.

Inspect the outside of the tensioner for discoloration patterns that may indicate submersion and internal damage.

Perform an inventory of the loose equipment supplied with the tensioner. An inventory list is provided on the tensioner's technical drawing (Riverhawk HT-xxxx listed in section 2.0 and 4.5). Replacement parts are available from Riverhawk.

7.1.1.1 Hydraulic Tensioner's Burst Disc Replacement

The hydraulic tensioner's burst disc is a key element in the overall safe use of the hydraulic tensioner. The burst disc's location is shown on the tensioner's technical drawing (Riverhawk HT-xxxx listed in section 2.0 and 4.5).

Each tensioner is shipped from our factory with one burst disc already installed in the tensioner and with another spare disc for field replacement. Extra burst discs are available from Riverhawk for replacement purposes.

To replace a damaged burst disc:

1. Remove the hydraulic port's dispersion nut, compression ring, and damaged burst disc.
2. Discard the damaged burst disc.
3. Clean the dispersion nut, compression ring, new burst disc, and the hydraulic port with a solvent to ensure a dirt-free installation.
4. Reassemble new burst disc, compression ring, and dispersion nut into the same hydraulic port.

Warning

A damaged burst disc must be replaced with a burst disc of the same design and pressure rating. Do not substitute a damaged burst disc with a different disc type, a different pressure rating, or a foreign object.

7.1.2 Hydraulic Pump Kit Inspection

Refer to the Hydraulic Pump Kit Instruction Manual, IM-293 (GE VENDOC 373A4058). The latest revision may be obtained by contacting Riverhawk Company or thru www.riverhawk.com.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

7.2 Hydraulic Fittings

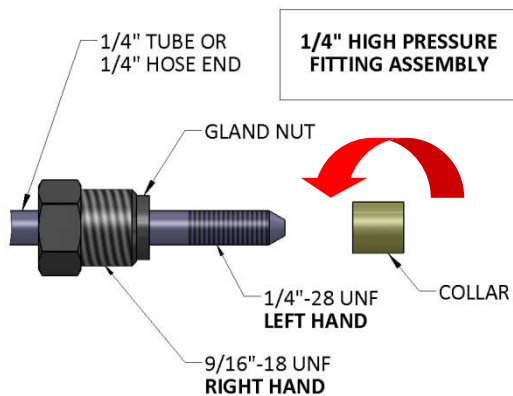


Illustration 1

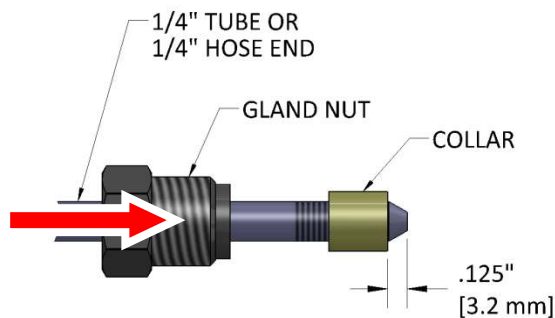


Illustration 2

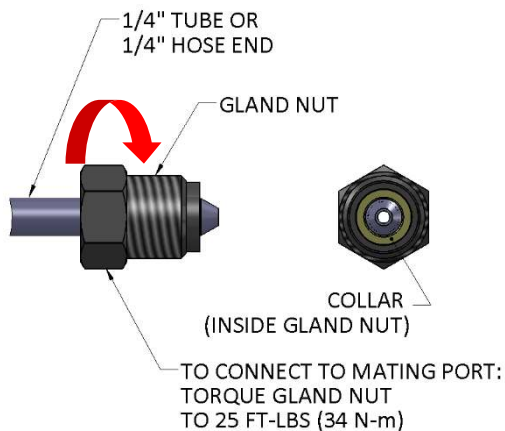


Illustration 3

Riverhawk hydraulic pumps use a 1/4" High Pressure port to connect its hydraulic hoses. The hose connector is made from a three piece assembly: a gland nut, a collar, and a 1/4" tube or 1/4" hose end. (See Illustration 1)

To assembly the fitting, slide the gland nut over the 1/4" tube or 1/4" hose end. Turn the collar counter-clockwise (**left hand** thread) on to the tube or hose end as shown in Illustration 1.

The collar should be placed .125" (3.2 mm) from the tip of the cone. (See Illustration 2) It may be necessary to adjust this collar with a set of vise-grip pliers. Be careful to not strip the threads off the tube or hose end.

Slide the gland nut down over the collar. (See Illustration 3) Insert the 1/4" tube or 1/4" hose end into the tensioner's quick coupler. While firmly holding the tube or hose end to stop it from rotating, turn the gland nut clockwise (**right hand** thread) and torque the gland nut to 25 FT-LBS (34 N-m).

Tips:

- Make sure all parts are clean and free from debris.
- Protect the cone on the end of the 1/4" tube or 1/4" hose end from scratches as this is the sealing surface.
- Replace red plastic caps when finished to protect the threads and cone.

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

IM-406 Revision G
Page 25 of 50

8.0 Assembly of Tensioner on a Stud


8.1 Handling of the Tensioner

The tensioner used in this application is designed to require no special lifting instructions. Do not drop any part of the tensioner on the operator or other nearby personnel.

8.2 Kit Assembly

Connect the hydraulic hose from the hydraulic pump to the tensioner. **Do not pressurize** the tensioner at this time or you may cause damage to the tensioner.

Refer to the hardware assembly drawing (HF-xxxx) listed in Section 2.0 of this manual and the tensioner assembly drawing (HT-xxxx) listed in Section 4.5 of this manual to determine how the tensioner must be assembled on the load coupling for its correct operation.

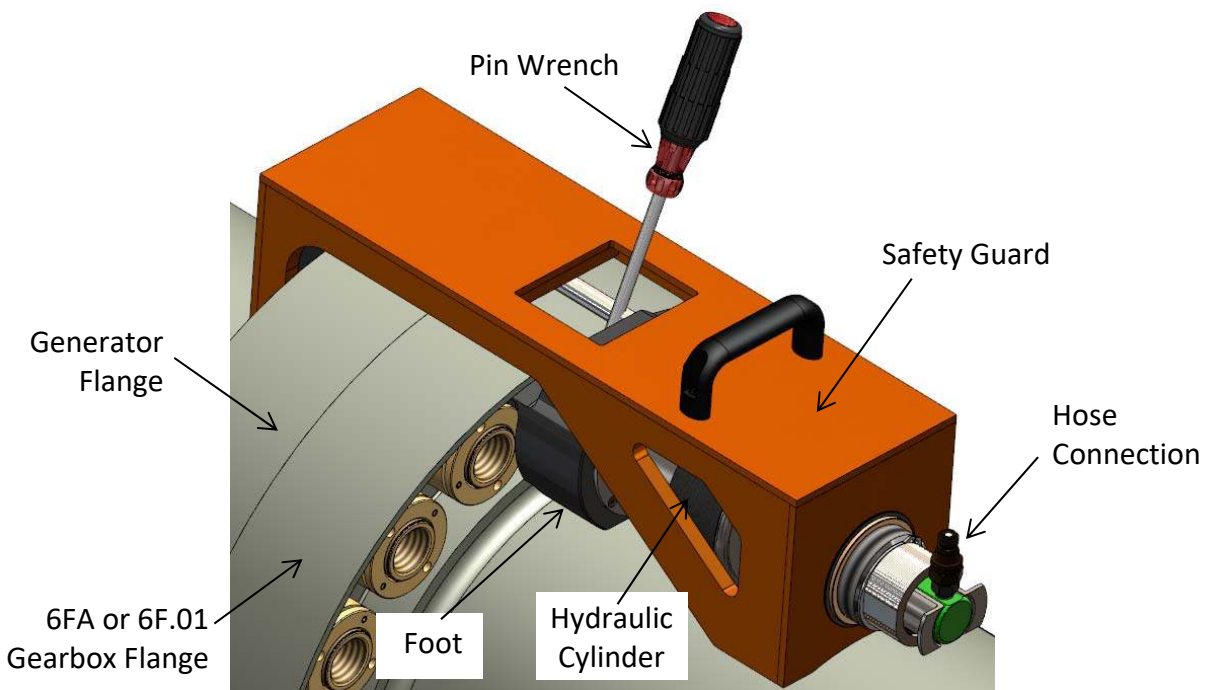

Picture 8A – Features of the Hydraulic Tensioner HT-6754 shown on 6FA, 6F.03, or 6F.01 Gearbox to Generator Bolted Flange Connection




215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com


CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 26 of 50

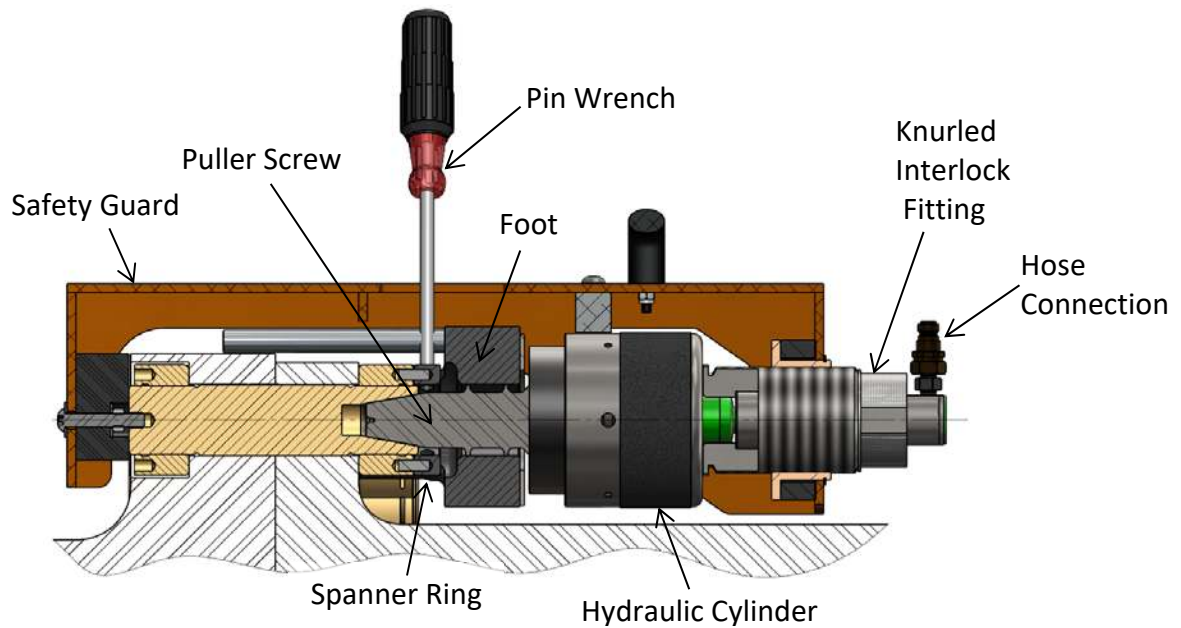

Picture 8B – Cutaway view of Hydraulic Tensioner HT-6754 shown on 6FA, 6F.03, or 6F.01 Gearbox to Generator Bolted Flange Connection

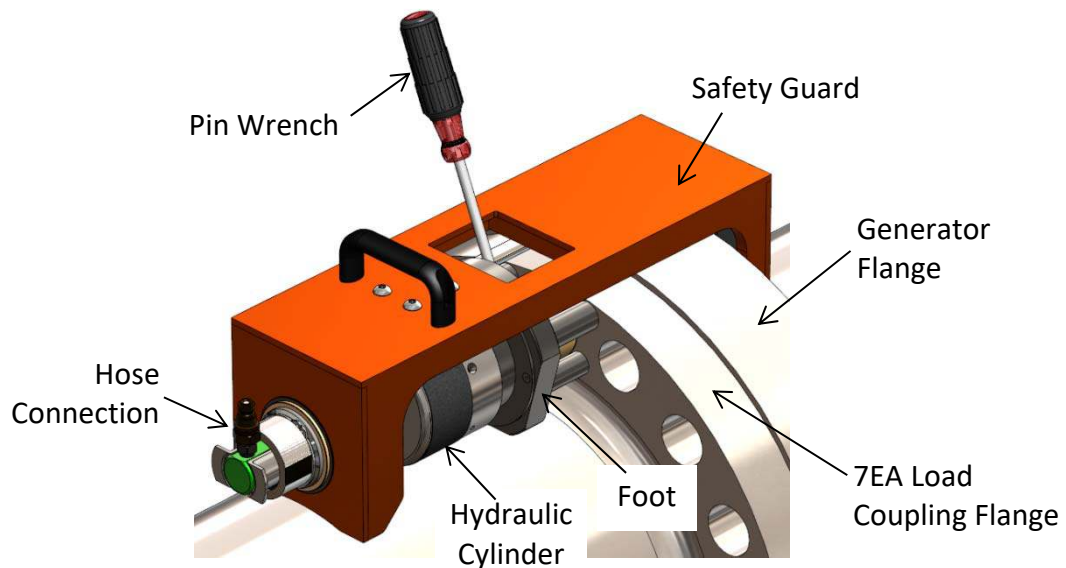

Picture 8C – Features of the Hydraulic Tensioner HT-5210 shown on 7EA Load Coupling to Generator Bolted Flange Connection.


Note: HT-5210 has been superseded by HT-6754.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com


CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

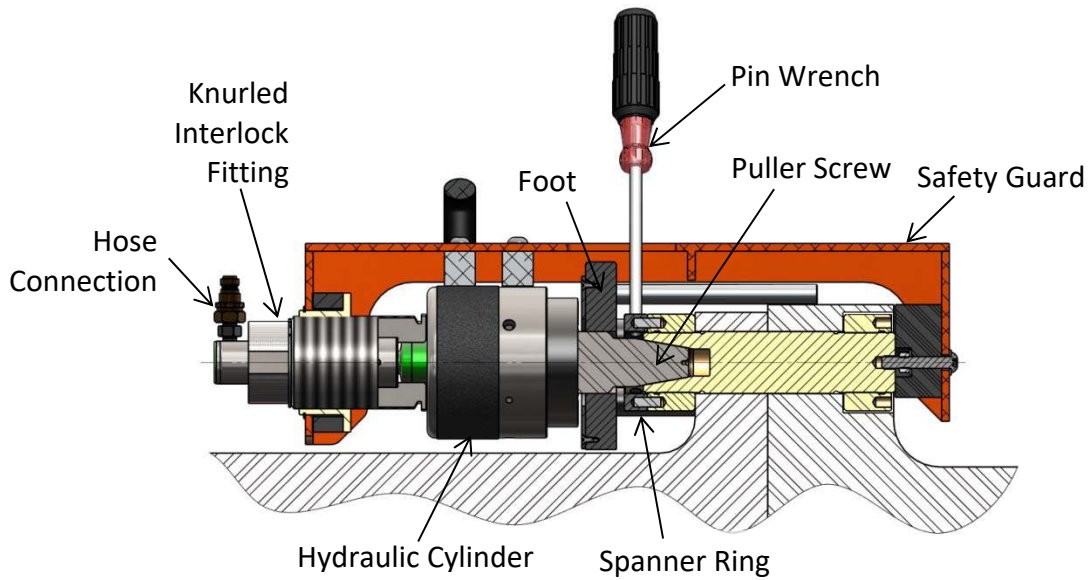

Picture 8D – Cutaway view of Hydraulic Tensioner HT-5210 shown on 7EA Load Coupling to Generator Bolted Flange Connection.

Note: HT-5210 has been superseded by HT-6754.

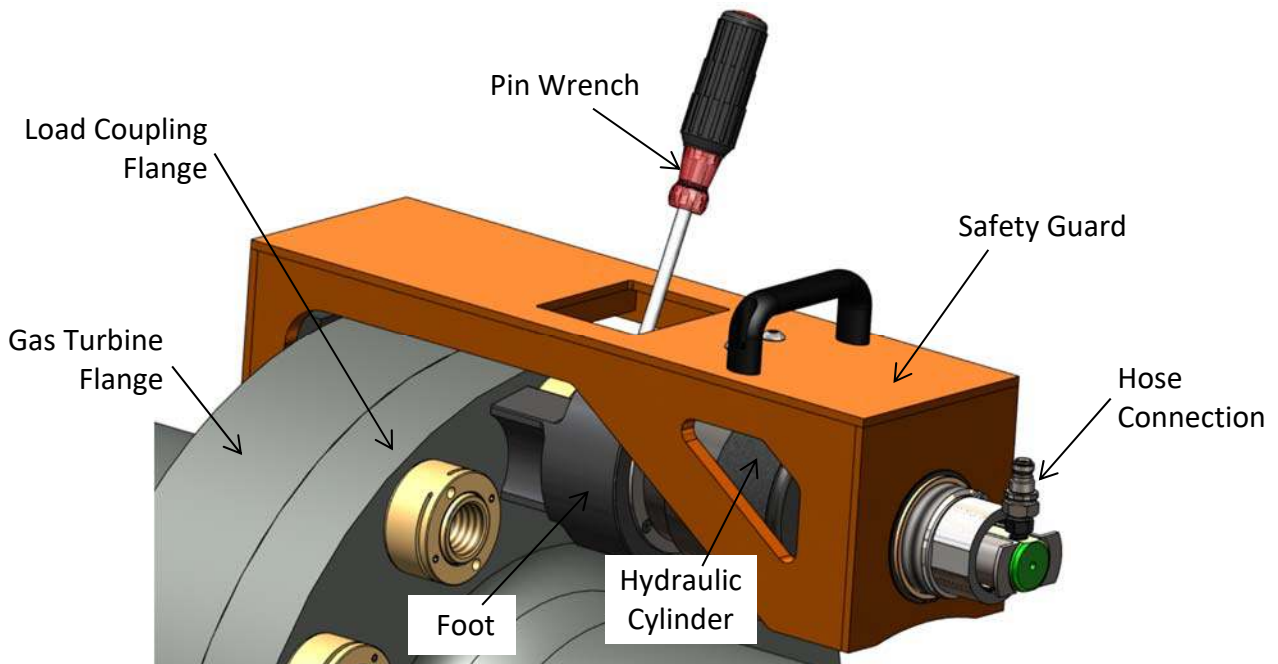

Picture 8E – Features of the Hydraulic Tensioner HT-6754 shown on 7EA or 7E.03 Gas Turbine to Load Coupling Bolted Flange Connection




215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 28 of 50

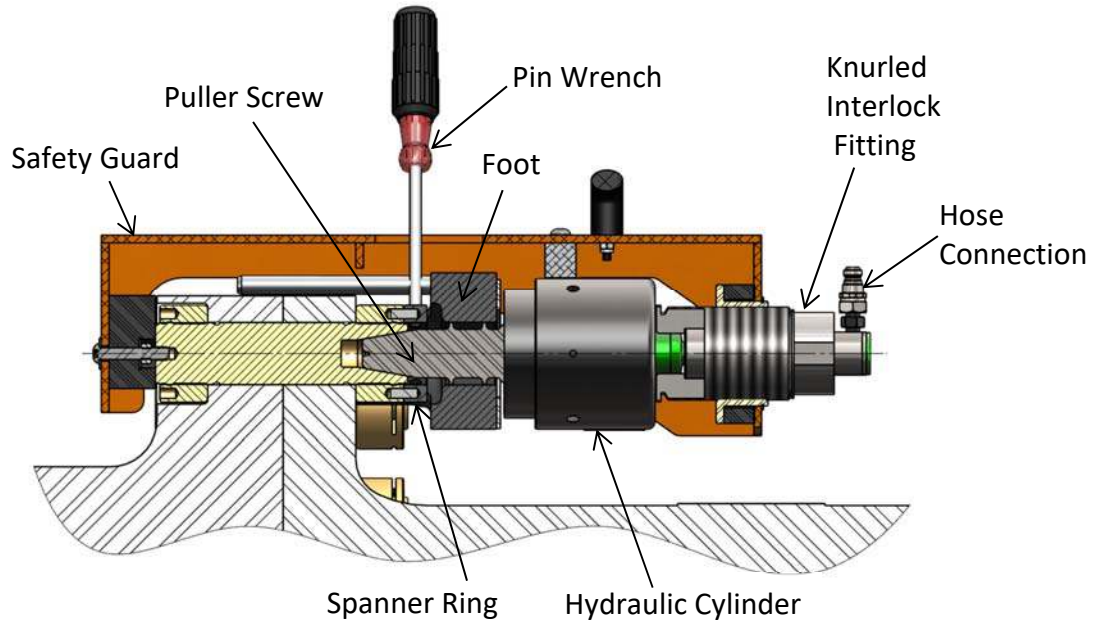

Picture 8F – Cutaway view of Hydraulic Tensioner HT-6754 shown on 7EA or 7E.03 Gas Turbine to Load Coupling Bolted Flange Connection

Note: Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. Do not use "Never Seize" on the conical threads. This procedure will ease assembly and assure positive mating of the threads before tightening.

Assembly sequence is as follows:

1. Open the hydraulic return valve on the pump to allow hydraulic fluid to be pushed back from the puller tool into the pump reservoir. (This is automatic on the air-operated hydraulic pump)
2. Insert the puller screw into the tapered thread of the stud and hand tighten. **Be sure not to cross-thread the puller screw.**
3. Place the spanner ring on the nut.
4. Using an Allen wrench, tighten the puller screw and then back off the puller screw 1/2 a turn.
5. Retighten the puller screw by hand until it is fully inserted. **DO NOT BACK OFF THE PULLER SCREW.**
6. Place the foot over the puller screw and orientate it into position.




215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 29 of 50

7. Thread the tensioner onto the puller screw until it stops. Please note that the internal stop inside the tensioner will cause a gap in between the foot and tensioner. The gap should be 1/16" [1.6mm] to 3/16" [4.8mm]. **DO NOT ATTEMPT TO TIGHTEN THE TENSIONER AGAINST THE FOOT.**
8. Place the guard over the tensioner and position the guide pin into the hole in the backside of the stud.
9. Tighten the knurled interlock fitting by hand until it firmly presses against the tensioner. There should be no gap between the tensioner the interlock fitting.
10. Activate the custom connector from the rear of guard by pushing on the center with your thumb and pulling the tabs with your fore finger and middle finger. Push the assembly forward until it locks into the tensioner. Release fingers from the tabs and then remove thumb, Ensure connection is firmly engaged or else the tensioner will not be connected to the pump.

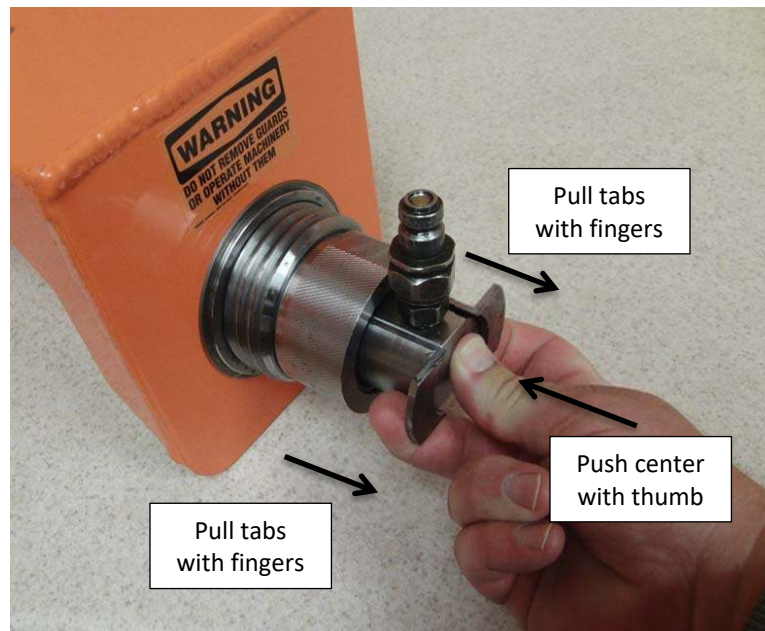

Picture 8E - Activation of the safety interlock

11. Connect the hydraulic pump to the tensioner. The tensioner should now be completely assembled and ready for use.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

8.3 Bleeding Hydraulic System

WARNING

To avoid failure, ensure safety, and proper operation, the tensioner assembly must be installed on a stud in the flange before bleeding and pressurizing the tensioner. Do not use the tensioner at any pressure unless the tool is installed on a stud in a flange.

Bleeding of the hydraulic system is not necessary with this tensioner design.

9.0 Stud Tensioning

The studs will be tensioned in two steps, at 50% pressure and at final pressure. Follow the tensioning sequence for each flange joint as defined on the record sheets found at the end of this manual.

9.1 Tensioning at 50% pressure

After the tensioner is properly installed apply hydraulic pressure to the tool. Bring the pressure to the 50% level in accordance with the following table.

WARNING

The safety cage must be in place at all times. Keep hands out of designated areas at all times when the tensioner is pressurized otherwise personal injury can occur.

CAUTION

Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. This procedure will ease assembly and assure positive mating of the threads before tightening. Do not use "Never Seize" on the conical threads.

CAUTION

Do not exceed the maximum pressure marked on the tensioner. Excessive pressure can damage the stud and puller screw.

CAUTION

Do not tighten the nut while the tool is coming up to pressure; wait until pressure is achieved before attempting to tighten the nut with the spanner ring. If the tool is not properly installed, the tool could jump off the stud while coming up to pressure.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

<u>Flange Position</u>	<u>Stud Size</u>	<u>50% Pressure</u>	<u>50% Stretch</u>
6FA Load Gear to Generator	2" [51 mm]	8000 psi [550 bar]	Do not measure Do not use
6F.03 Load Gear to Generator	2" [51 mm]	8000 psi [550 bar]	Do not measure Do not use
6F.01 Load Gear to Generator	2" [51 mm]	6000 psi [410 bar]	Do not measure Do not use
7EA Gas Turbine to Load Coupling	2" [51 mm]	9000 psi [620 bar]	Do not measure Do not use
7EA Load Coupling to 7A6 Generator	2" [51 mm]	8000 psi [550 bar]	Do not measure Do not use
7E.03 Gas Turbine to Load Coupling	2" [51 mm]	9000 psi [620 bar]	Do not measure Do not use
7E.03 Load Coupling to A36 Generator	2" [51 mm]	8000 psi [550 bar]	Do not measure Do not use

Firmly tighten the cylindrical nuts with approximately 10 ft·lbs [13.5 N·m] of torque using the pin wrench and spanner ring. Continue to turn the nut until it contacts the flange.

9.2 Removing the Tensioner from an Installed Stud

The tensioner removal is accomplished by the follows steps:

1. Release the hydraulic pressure by either releasing the hand switch on the AP-0532 Pump Kit or by opening the valve on the MP-0130 Manual Pump Kit and leave the valve open.
2. Unscrew the knurled interlock fitting at the end of the guard and remove the guard from the tensioner.
3. Unscrew the tensioner from puller screw.
4. Remove foot from around the puller screw.
5. Remove the spanner ring from the nut.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

6. Unscrew the puller screw using an Allen wrench. Tapping the Allen wrench with a hammer or the use of a breaker bar may be necessary to loosen the puller screw. Do not use an impact wrench as this can damage the puller screw.
7. Move the tool to the next bolt hole following the tensioning pattern from the stretched record sheets at the end of this manual.

9.3 Tensioning at Final Pressure

Repeat the pulling and tightening procedure stated above at full pressure. After all of the studs have been tensioned, measure the final stud length. The final pressure and required stretch values are listed in the following table.

WARNING

The safety cage must be in place at all times. Keep hands out of designated areas at all times when the tensioner is pressurized otherwise personal injury can occur.

CAUTION

Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. This procedure will ease assembly and assure positive mating of the threads before tightening. Do not use "Never Seize" on the conical threads.

CAUTION

Do not exceed the maximum pressure marked on the tensioner. Excessive pressure can damage the stud and puller screw.

CAUTION

Do not tighten the nut while the tool is coming up to pressure; wait until pressure is achieved before attempting to tighten the nut with the spanner ring. If the tool is not properly installed, the tool could jump off the stud while coming up to pressure.

<u>Flange Position</u>	<u>Stud Size</u>	<u>Final Pressure</u>	<u>Final Stretch</u>
6FA Load Gear to Generator	2" [51 mm]	16000 psi [1100 bar]	0.010" - 0.012" [0.25 mm - 0.31 mm]
6F.03 Load Gear to Generator	2" [51 mm]	16000 psi [1100 bar]	0.010" - 0.012" [0.25 mm - 0.31 mm]



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

6F.01 Load Gear to Generator	2" [51 mm]	10500 psi [720 bar]	0.006" - 0.008" [0.15 mm - 0.20 mm]
7EA Gas Turbine to Load Coupling	2" [51 mm]	19000 psi [1310 bar]	0.013" - 0.015" [0.33 mm - 0.38 mm]
7EA Load Coupling to 7A6 Generator	2" [51 mm]	16000 psi [1100 bar]	0.010" - 0.012" [0.25 mm - 0.31 mm]
7E.03 Gas Turbine to Load Coupling	2" [51 mm]	19000 psi [1310 bar]	0.013" - 0.015" [0.33 mm - 0.38 mm]
7E.03 Load Coupling to A36 Generator	2" [51 mm]	16000 psi [1100 bar]	0.010" - 0.012" [0.25 mm - 0.31 mm]


Firmly tighten the cylindrical nuts with approximately 10 ft·lbs [13.5 N·m] of torque using the pin wrench and spanner ring. Continue to turn the nut until it contacts the flange.

Failure to achieve the correct final stretch values will result in an incorrectly tensioned stud.

Incorrect stretch values can be corrected by uninstalling some or all of the selected studs. Re-measure the initial length of the studs and repeat the installation instructions studs. Excessive stretch variations can also be corrected by the same method.

Have final stretch values approved by the supervisor responsible for the installation.

10.0 Thread Locking the Nut

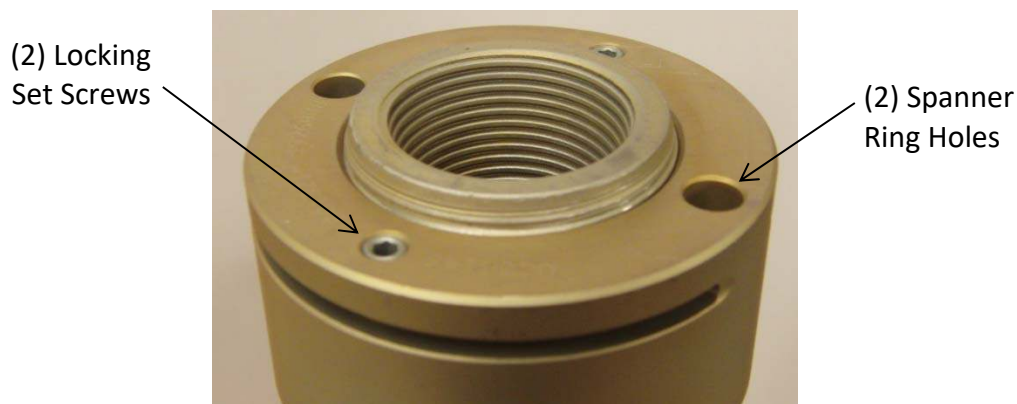

Picture 10A - Riverhawk Locknut



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

Mechanical lock nuts have two set screws located in the top face. Before threading the nut onto the stud, check to be certain the set screws are free to turn. Once the nut is seated torque the set screws to the values specified in the following table. When seated and torqued to the values specified, the load created by the set screw displaces the thread of the nut in the area of the web thereby creating the desired locking action.

<u>Flange Position</u>	<u>Stud Size</u>	<u>Set Screw Size</u>	<u>Torque</u>
6FA Load Gear to Generator	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
6F.03 Load Gear to Generator	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
6F.01 Load Gear to Generator	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
7EA Gas Turbine to Load Coupling	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
7EA Load Coupling to 7A6 Generator	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
7E.03 Gas Turbine to Load Coupling	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]
7E.03 Load Coupling to A36 Generator	2" [51 mm]	1/4"-28UN	65 in·lbs - 87 in·lbs [7.3 N·m – 9.8 N·m]

11.0 Stud and Nut Removal

11.1 Handling of the Tensioner

The tensioner used in this application is designed for no special lifting instructions. Do not drop any part of the tensioner on the operator or other nearby personnel.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

<u>CUSTOMER'S INFORMATION BOX</u>	
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL	
GE DRAWING NUMBER	REV
373A4099	

11.2 Stud and Nut Removal

WARNING

The safety cage must be in place at all times. Keep hands out of designated areas at all times when the tensioner is pressurized otherwise personal injury can occur.

CAUTION

Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. This procedure will ease assembly and assure positive mating of the threads before tightening. Do not use "Never Seize" on the conical threads.

CAUTION

Do not exceed the maximum pressure marked on the tensioner. Excessive pressure can damage the stud and puller screw.

CAUTION

Do not tighten the nut while the tool is coming up to pressure; wait until pressure is achieved before attempting to tighten the nut with the spanner ring. If the tool is not properly installed, the tool could jump off the stud while coming up to pressure.

Refer to the hardware assembly drawing (HF-xxxx) listed in Section 2.0 of this manual and the tensioner assembly drawing (HT-xxxx) listed in Section 4.5 of this manual to determine how the tensioner must be assembled on the load coupling for its correct operation.

Section 8.0 contains diagrams of the tensioner equipment.

Note: Before threading the puller screw into the stud, carefully check the cleanliness of both the stud's and the puller screw's conical threads. Apply a light coat of clean turbine oil or a spray lubricant to the puller screw. Do not use "Never Seize" on the conical threads. This procedure will ease assembly and assure positive mating of the threads before tightening.

Disassembly sequence is as follows:

1. If present, remove the windage plugs from the studs by loosening the plug's set screws with an Allen wrench and then unscrew the plug from the stud. It may be necessary to use either a flat-bladed screwdriver or another Allen wrench to stop the windage plug from rotating. Do not misplace the set screws.
2. Using a wire brush (GT-4354) and shop air, clean the internal tapered thread of the stud to remove any debris/deposits which may have accumulated during service as described in section 5.2.2. Do not continue until ALL debris is removed from the threads.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 36 of 50

WARNING

Do not use a hydraulic tensioner to remove a stud with damaged conical threads.

3. With an Allen wrench, loosen the nut's two locking set screws but do not remove them from the nut.



Picture 11A - Loosening of a nut's set screws

4. Connect the hydraulic hose from the hydraulic pump to the tensioner. **Do not pressurize** the tensioner at this time or you may cause damage to the tensioner.
5. Open the hydraulic return valve on the pump to allow hydraulic fluid to be pushed back from the puller tool into the pump reservoir. (This is automatic on the air-operated hydraulic pump)
6. Insert the puller screw into the tapered thread of the stud and hand tighten. **Be sure not to cross-thread the puller screw.**
7. Place the spanner ring on the nut.
8. Using an Allen wrench, tighten the puller screw and then back off the puller screw 1/2 a turn.
9. Retighten the puller screw by hand until it is fully inserted. **DO NOT BACK OFF THE PULLER SCREW.**
10. Place the foot over the puller screw and orientate it into position.
11. Thread the tensioner onto the puller screw until it stops. Please note that the internal stop inside the tensioner will cause a gap in between the foot and tensioner. The gap should be 1/16" [1.6mm] to 3/16" [4.8mm]. **DO NOT ATTEMPT TO TIGHTEN THE TENSIONER AGAINST THE FOOT.**




215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 37 of 50

12. Place the guard over the tensioner and position the guide pin into the hole in the backside of the stud.
13. Tighten the knurled interlock fitting by hand until it firmly presses against the tensioner. There should be no gap between the tensioner the interlock fitting.
14. Activate the custom connector from the rear of guard by pushing on the center with your thumb and pulling the tabs with your fore finger and middle finger. Push the assembly forward until it locks into the tensioner. Release fingers from the tabs and then remove thumb, Ensure connection is firmly engaged or else the tensioner will not be connected to the pump.

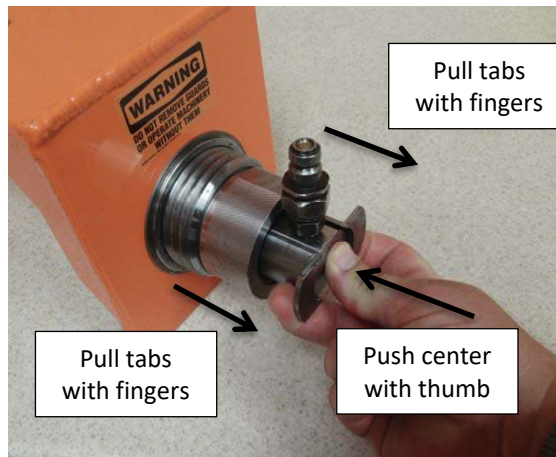

Picture 11B - Activation of the safety interlock

15. Connect the hydraulic pump to the tensioner and apply the appropriate hydraulic pressure per this table.

<u>Flange Position</u>	<u>Stud Size</u>	<u>Final (100%) Pressure</u>
6FA Load Gear to Generator	2" [51 mm]	16000 psi [1100 bar]
6F.03 Load Gear to Generator	2" [51 mm]	16000 psi [1100 bar]
6F.01 Load Gear to Generator	2" [51 mm]	10500 psi [720 bar]



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

7EA Gas Turbine to Load Coupling	2" [51 mm]	19000 psi [1310 bar]
7EA Load Coupling to 7A6 Generator	2" [51 mm]	16000 psi [1100 bar]
7E.03 Gas Turbine to Load Coupling	2" [51 mm]	19000 psi [1310 bar]
7E.03 Load Coupling to A36 Generator	2" [51 mm]	16000 psi [1100 bar]

16. Turn the spanner ring with the pin wrench. Loosen and turn the nut approximately 3/4 of a turn.

17. Release the hydraulic pressure.

11.3 Removing the Tensioner from a Stud

The tensioner removal is accomplished by the follows steps:

1. Release the hydraulic pressure by either releasing the hand switch on the AP-0532 Pump Kit or by opening the valve on the MP-0130 Manual Pump Kit and leave the valve open.
2. Unscrew the knurled interlock fitting at the end of the guard and remove the guard from the tensioner.
3. Unscrew the tensioner from puller screw.
4. Remove foot from around the puller screw.
5. Remove the spanner ring from the nut.
6. Unscrew the puller screw using an Allen wrench. Tapping the Allen wrench with a hammer or the use of a 1'-2' breaker bar may be necessary to loosen the puller screw. Do not use an impact wrench as this can damage the puller screw.
7. Move the tool to the next bolt hole following the tensioning pattern from the stretched record sheets at the end of this manual.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

12.0 Storage Instructions

Follow these directions to properly store your hydraulic tensioner and hydraulic pump kit for long term storage and shipment.

If any damage is observed, contact the Riverhawk Company to schedule a maintenance inspection.

12.1 Hydraulic Pump Kit Storage

Refer to the Hydraulic Pump Kit Instruction Manual, IM-293 (GE VENDOC 373A4058). The latest revision may be obtained by contacting Riverhawk Company or thru www.riverhawk.com.

12.2 Hydraulic Tensioner Storage

Check the tensioner for any damage:

1. Clean puller screw and check for any debris and dents.
2. Knurled interlock fitting should be clean and free to rotate.
3. Inspect the tensioner guard for any signs of damage. Bent guards must be replaced.

If any damage is observed, contact the Riverhawk Company to schedule a maintenance inspection.

Place the protective plastic cap on the guard's knurled interlock fitting.

Coat the hydraulic tensioner with a light coat of oil and place the tensioner into the original shipping container.

12.3 Store shipping container

Secure the hydraulic pump and hydraulic tensioner into the original shipping containers using the supplied wood braces.

Seal the original shipping container and store under shelter and protected from moisture, sand, and grit.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

13.0 Frequently Asked Questions

This section contains some frequently asked questions and problems. If the steps listed here do not solve your problem, contact the Riverhawk Company thru our website, email, or phone call.

Q: Can I rent a hydraulic tensioner kit?

A: Yes, Riverhawk has rental tensioner kits available for most of our hydraulic tensioners.

Q: A tensioner has pulled itself out of the stud's conical threads. Can I continue using a tensioner on this stud?

A: No. Both the tensioner and the stud may have been damaged and must be removed from the work area. If the stud is tensioned, a Nut Buster repair kit, from Riverhawk, must be used to remove the damaged stud by drilling out the nut. Leaving a damaged stud in place will lead to a safety hazard on future outages.

Riverhawk can supply a replacement stud and nut based on the initial weight certification supplied with the hardware set (see section 4.2). The damaged tensioner should also be returned to Riverhawk for inspection and repair.

If a stud must be left in place, paint the damaged stud with a generous amount of indelible, bright-colored paint. Notify the appropriate GE Safety and Service personnel. Note the location of the damaged stud in the services notes for the machine.

Q: The hydraulic tensioner has been taken up to its final pressure. The final stretch length is short of the final stretch target. What is the next step?

A: Do not increase the hydraulic pressure. Check if the hydraulic pump is set to the right pressure. Install the tensioner and re-pressurize the tensioner to the final pressure then recheck the stretch measurement. If the stretch value is still short, remove the stud from the hole and re-measure the stud's initial length then try to install the stud again.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- Q:** The hydraulic tensioner has been taken up to its final pressure. The final stretch length is larger than the final stretch target. What is the next step?
- A:** Remove the stud from the bolt hole. Check if the hydraulic pump is set to the right pressure. Re-measure the stud's initial length then try to install the stud again.
- Q:** The tensioner is at its final pressure, but the nut cannot be loosened.
- A:** If the nuts cannot be loosened at the final pressure, continually increasing the pressure will not help and can be dangerous and in some cases make it harder to remove the nut. Check the nut to see if its set screws have been loosened. Check for and remove any corrosion around the nut's threads. Apply penetrating oil between the stud and the nut.
- Q:** How do I clean the conical threads on a stud?
- A:** The conical threads are best cleaned using a spiral wound brass brush in a drill as described in section 5.2.2
- Q:** During the initial steps of removing a tensioned stud, the stick-out length is found to be wrong.
- A:** Do not proceed. Contact Riverhawk for assistance. With the wrong stick-out length, the hydraulic tensioner has a limited stroke and may not work properly and can be damaged.
- Q:** The hydraulic pump appears to be leaking.
- A:** Check the hose connection to the hydraulic pump. If the 1/4" high pressure fitting is not assembled correctly as shown in section 7.2, it may look like the pump is leaking. If the problem continues, it may be necessary to open the pump kit. Contact Riverhawk for guidance.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

- Q:** The hydraulic hose has a collar on it that can't be moved by hand
- A:** The hydraulic fitting is shown in section 7.2. The collar is sometimes held in place with a thread locking compound. This prevents the collar from moving too easily. It may be necessary to adjust this collar with a set of vise-grip pliers. Be careful to not strip the threads off the tube or hose end.

14.0 Revision History

Revision Letter	Effective Date	Description
G	Jan 27, 2022	Updated EC Declaration of Conformity; Added UKCA Declaration of Conformity
F	Dec 19, 2019	Added 7E.03 to A36 and 134T7922 to title page; Inserted sections 2.10 thru 2.12; Added 133T8375 to section 2.13; Added 7E.03 to section 3 and Figure 6B; Added A36 to Figure 6C; Inserted Figure 6H, Picture 8E, and Picture 8F; Added 7E.03 to charts in sections 9.1, 9.3, 10.0, 11.2, and into Appendix B4 and B5
E	Aug 13, 2019	Added 133T8375 to title page; Inserted section 2.1; Added 133T8375 to section 2.5
D	Nov 20, 2018	Added Fr. 6F.03-FL18 and 131T2640 to title page; Inserted Appendix B2; Inserted sections 2.1 and 2.2; Added 131T2640P0002 and P0005 to section 2.9; Added 6F.03 to Figure 6A, Picture 8A, and Picture 8B; Added Picture 6E; Added 6F.03 to tables in sections 9.1, 9.3, 10.0, and 11.2
C	Sep 27, 2018	Revised metric conversions on set screw torques in section 10
B	Sep 28, 2017	Added 381A6850P021, P022, P023, P024 to title page; inserted section 2.2



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

Revision Letter	Effective Date	Description
A	Mar 17, 2017	Added 102T1200 and 358A7395 to title page; Inserted sections 2.3, 2.4, and 2.5; Updated section 3 for 7EA applications; Inserted Figures 6B and 6C; Inserted Pictures 6F, 8C, and 8D; Added 7EA to hydraulic pressure tables in sections 9.1, 9.3, and 11.2; Added 7EA to torque table in section 10.0; Added Appendix B3 and B4
-	Sep 29, 2016	Released

Appendix A1

EC Declaration of Conformity

Manufacturer: Riverhawk Company
Address: 215 Clinton Road
New Hartford, NY 13413, USA

The hydraulic pump and bolt tensioning tool described in this manual are used for installing and applying tension to large bolts that are specifically designed by Riverhawk Company to be tensioned hydraulically.

All applicable sections of European Directive 2006/42/EC for machinery have been applied and fulfilled in the design and manufacture of the hydraulic pump and bolt tensioning tool described in this manual. Reference also ISO 12100:2010, ISO 4413:2010, and ISO 4414:2010.

Furthermore, this equipment has been manufactured under the Riverhawk quality system per EN ISO 9001:2015

Consult the Declaration of Conformance included with the shipment of this equipment that identifies the authorized Riverhawk representative, applicable serial numbers, and appropriate signature.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

Appendix A2

UKCA Declaration of Conformity

Manufacturer: Riverhawk Company
Address: 215 Clinton Road
New Hartford, NY 13413, USA

The hydraulic pump and bolt tensioning tool described in this manual are used for installing and applying tension to large bolts that are specifically designed by Riverhawk Company to be tensioned hydraulically.

All applicable sections of Supply of Machinery (Safety) 2008 have been applied and fulfilled in the design and manufacture of the hydraulic pump and bolt tensioning tool described in this manual. Reference also ISO 12100:2010, ISO 4413:2010, and ISO 4414:2010.

Furthermore, this equipment has been manufactured under the Riverhawk quality system per EN ISO 9001:2015

Consult the Declaration of Conformance included with the shipment of this equipment that identifies the authorized Riverhawk representative, applicable serial numbers, and appropriate signature.



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

IM-406 Revision G
Page 45 of 50

Appendix B1


STRETCH RECORD SHEET FOR
THE 6FA LOAD GEAR TO GENERATOR

TURBINE NUMBER:

DATE:

TECHNICIAN:

SUPERVISOR:

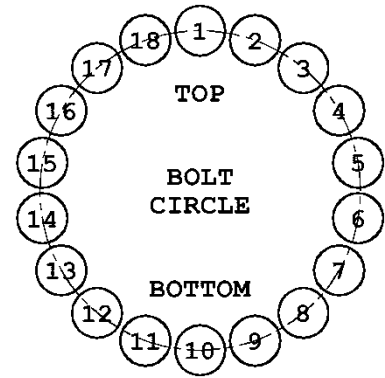

HOLE NUMBER	STARTING LENGTH	FINAL LENGTH	FINAL STRETCH
1			
10			
2			
11			
3			
12			
4			
13			
5			
14			
6			
15			
7			
16			
8			
17			
9			
18			



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

Appendix B2


STRETCH RECORD SHEET FOR THE 6F.03 LOAD GEAR TO GENERATOR

TURBINE NUMBER:

DATE:

TECHNICIAN:

SUPERVISOR:

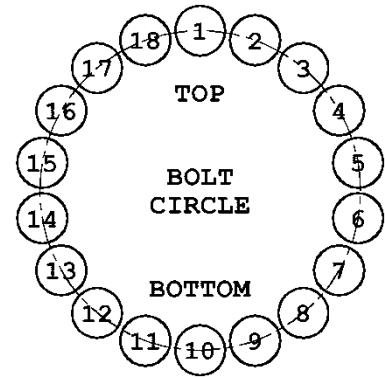

HOLE NUMBER	STARTING LENGTH	FINAL LENGTH	FINAL STRETCH
1			
10			
2			
11			
3			
12			
4			
13			
5			
14			
6			
15			
7			
16			
8			
17			
9			
18			

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

Appendix B3


STRETCH RECORD SHEET FOR
THE **6F.01** LOAD GEAR TO GENERATOR

TURBINE NUMBER:

DATE:

TECHNICIAN:

SUPERVISOR:

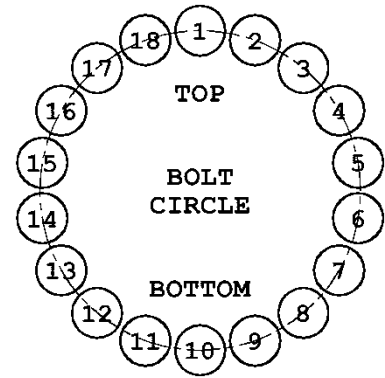

HOLE NUMBER	STARTING LENGTH	FINAL LENGTH	FINAL STRETCH
1			
10			
2			
11			
3			
12			
4			
13			
5			
14			
6			
15			
7			
16			
8			
17			
9			
18			



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX
CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

Appendix B4


STRETCH RECORD SHEET FOR THE **7EA** or **7E.03** GAS TURBINE TO LOAD COUPLING

TURBINE NUMBER:

DATE:

TECHNICIAN:

SUPERVISOR:

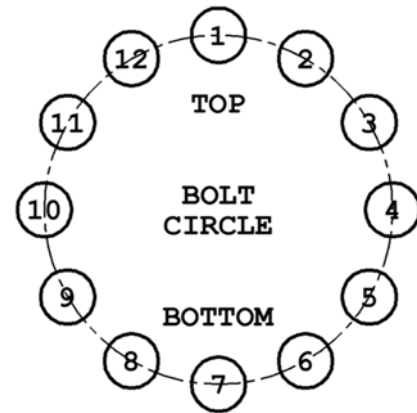

HOLE NUMBER	STARTING LENGTH	FINAL LENGTH	FINAL STRETCH
1			
7			
2			
8			
3			
9			
4			
10			
5			
11			
6			
12			



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	

Appendix B5


STRETCH RECORD SHEET FOR
THE 7EA or 7E.03 LOAD COUPLING TO GENERATOR

TURBINE NUMBER:

DATE:

TECHNICIAN:

SUPERVISOR:

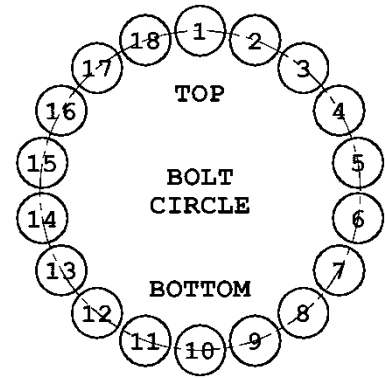

HOLE NUMBER	STARTING LENGTH	FINAL LENGTH	FINAL STRETCH
1			
10			
2			
11			
3			
12			
4			
13			
5			
14			
6			
15			
7			
16			
8			
17			
9			
18			

CUSTOMER'S INFORMATION BOX

CONTENTS ARE INDEPENDENT OF RIVERHAWK DOCUMENT CONTROL

GE DRAWING NUMBER	REV
373A4099	



215 Clinton Road
New Hartford, NY 13413
Tel: +1 315 768 4855
Fax: +1 315 768 4941
Email: info@riverhawk.com